USER MANUAL

MULTIPROTOCOL “KEY” GATEWAYS SERIES

IEC 61850 - MODBUS RTU&TCP GATEWAYS

SENECA S.r.l.
Via Austria 26 – 35127 – Z.I. - PADOVA (PD) - ITALY
Tel. +39.049.8705355 – 8705355 Fax +39 049.8706287
www.seneca.it

ORIGINAL INSTRUCTIONS

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

CAUTION

SENECA does not guarantee that all specifications and/or aspects of the product and firmware, included in them, will meet the requirements of the actual final application even if the product referred to in this documentation is in compliance with the technological state of the art.
The user assumes full responsibility and/or risk with regard to the configuration of the product to achieve the intended results in relation to the specific installation and/or end application.
SENECA may, with prior agreement, provide consultancy services for the successful completion of the final application, but under no circumstances can it be held responsible for its proper functioning.
The SENECA product is an advanced product, the operation of which is specified in the technical documentation supplied with the product itself and/or can be downloaded, if desired prior to purchase, from the www.seneca.it website.
SENECA has a policy of continuous development and accordingly reserves the right to make and/or introduce - without prior notice - changes and/or improvements to any product described in this documentation.
The product described in this documentation may solely and exclusively be used by personnel qualified for the specific activity and in accordance with the relevant technical documentation, with particular attention being paid to the safety instructions.
Qualified personnel means personnel who, on the basis of their training, competence and experience, are able to identify risks and avoid potential hazards that could occur during the use of this product.
SENECA products may only be used for the applications and in the manner described in the technical documentation relating to the products themselves.
To ensure proper operation and prevent the occurrence of malfunctions, the transport, storage, installation, assembly, maintenance of SENECA products must comply with the safety instructions and environmental conditions specified in this documentation.
SENECA's liability in relation to its products is governed by the general conditions of sale, which can be downloaded from www.seneca.it.
Neither SENECA nor its employees, within the limits of applicable law, will in any case be liable for any lost profits and/or sales, loss of data and/or information, higher costs incurred for goods and/or replacement services, damage to property and/or persons, interruption of activities and/or provision of services, any direct, indirect, incidental, pecuniary and non-pecuniary, consequential damages in any way caused and/or caused, due to negligence, carelessness, incompetence and/or other liabilities arising from the installation, use and/or inability to use the product.

CONTACT US	
Technical Support	support@seneca.it
Product information	sales@seneca.it

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Document revisions

DATE	REVISION	NOTES	AUTHOR
16/09/2024	0	First revision	MM
24/02/2025	1	Added led chapter Added modbus registers info chapter	MM
27/05/2025	2	Added new functions from firmware rev 111	MM

This document is the property of SENECA srl.
Copies and reproduction are prohibited unless authorised.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

TABLE OF CONTENTS

1. DESCRIPTION 6
1.1. IEC61850 PROTOCOL 6
1.2. FEATURES OF THE "KEY" SERIES COMMUNICATION PORTS 6

2. DEVICE HARDWARE REVISION 7

3. FLEX TECHNOLOGY FOR PROTOCOL CHANGE 8
3.1. CHANGING PROTOCOLS WITH THE SENECA DISCOVERY DEVICE SOFTWARE 9

4. LED MEANING 10
4.1. Z-KEY-I (IEC61850) MODEL LED 10
4.2. R-KEY-LT-I (IEC61850) MODEL LED 11
4.3. Z-KEY-2ETH-I (IEC61850) MODEL LED 12

5. ETHERNET PORT 13

6. FIRMWARE UPDATE 13

7. OPERATING MODE 14
7.1. GATEWAY IEC 61850 SERVER / MODBUS MASTER 14

8. IEC61850 IMPLEMENTATION ON THE "KEY" SERIES GATEWAYS 15
8.1. Basic SCL structure 15
8.2. Modbus variables 15
8.3. DataSet 15
8.4. Report Control Block (RCB) unbuffered/buffered in the SCL structure 16

9. GATEWAY CONFIGURATION 17
9.1. GATEWAY CONFIGURATION WITH THE WEBSERVER FOR THE "COPADATA IEC61850 CLIENT™" CLIENT 17

10. GATEWAY WEBSERVERS 25
10.1. WEBSERVER DEI GATEWAY "-I" 25
10.1.1. WEBSERVER MODE AND IEC61850 MODE 25
10.1.2. MANUAL PROCEDURE FOR SWITCHING FROM IEC61850 MODE TO WEBSERVER MODE AND VICE VERSA 25
10.1.3. STEP BY STEP GUIDE FOR THE FIRST ACCESS TO THE WEBSERVER 26
10.1.4. WEBSERVER DEVICE CONFIGURATION 27
10.1.4.1. WEBSERVER SECTIONS 28
10.1.4.2. "STATUS" SECTION 29
10.1.4.3. "SETUP" SECTION 30
10.1.4.3.1. SAVING A CONFIGURATION ON A FILE 34
10.1.4.3.2. IMPORTING A CONFIGURATION FROM A FILE 35
10.1.4.4. "SETUP COMMANDS/TAGS" SECTION 35
10.1.4.5. "I/O MAPPING" SECTION 36

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4.1. “SETUP IEC VARIABLES” SECTION 37
10.1.4.1. “SETUP IEC DATASET” SECTION 38
10.1.4.2. “SETUP IEC REPORT CONTROL BLOCK” SECTION 38
10.1.4.1. "FIRMWARE UPDATE" SECTION 40
10.1.4.1. "CERTIFICATE SETUP" SECTION 41
10.1.4.2. SERIAL “SERIAL TRAFFIC MONITOR” 41
10.1.4.1. LOCAL TIME SETUP 41

11. SUPPORTED MODBUS COMMUNICATION PROTOCOLS 42
11.1. SUPPORTED MODBUS FUNCTION CODES 42

12. RESETTING THE DEVICE TO ITS FACTORY CONFIGURATION 43

13. INFORMATION ABOUT MODBUS REGISTERS 44
13.1. NUMBERING OF "0-BASED" OR "1-BASED" MODBUS ADDRESSES 44
13.2. NUMBERING OF MODBUS ADDRESSES WITH "0-BASED" CONVENTION 45
13.3. NUMBERING OF MODBUS ADDRESSES WITH "1 BASED" CONVENTION (STANDARD) 45
13.4. BIT CONVENTION WITHIN A MODBUS HOLDING REGISTER 46
13.5. MSB and LSB BYTE CONVENTION WITHIN A MODBUS HOLDING REGISTER 46
13.6. REPRESENTATION OF A 32-BIT VALUE IN TWO CONSECUTIVE MODBUS HOLDING REGISTERS 47
13.7. TYPE OF 32-BIT FLOATING POINT DATA (IEEE 754) 48

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1. DESCRIPTION

The Z-KEY-I, R-KEY-LT-I, Z-KEY-2ETH-I products allow to convert data coming from the Modbus serial bus or Modbus TCP-IP Ethernet into the IEC61850 protocol or vice versa.

1.1. IEC61850 PROTOCOL

IEC 61850 is a standard for the design of automation systems for electrical substations. It is part of the International Electrotechnical Commission.
The data model defined in IEC 61850 is supported, for example, by the MMS protocol.

PROTOCOL	
Type of protocol	IEC 61850 server ICD edition 1.0 MMS (manufacture message specification) protocol supported Report Control Block buffered/unbuffered supported Encrypted connection with certificates supported Goose and SMV protocols not supported TLS 1.2 connection, X.509 certificate management

MEMORY	
Memory size of variables	max 50 IEC variables

1.2. FEATURES OF THE "KEY" SERIES COMMUNICATION PORTS

PRODUCT	*ETHERNET PORTS*	*SERIAL PORT # 1 RS232/RS485 CONFIGURABLE*	*RS485 SERIAL PORT # 2*	*ISOLATED SERIAL PORTS*
Z-KEY-I	1	1	1	Yes, both ports
R-KEY-LT-I	1	1	NO	NO
Z-KEY-2ETH-I	2	1	1	Yes, both ports

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2. DEVICE HARDWARE REVISION

With a view to continuous improvement, Seneca updates and makes the hardware of its devices increasingly more sophisticated. It is possible to know the hardware revision of a product via the label on the side of the device.
An example of an R-KEY-LT product label is the following:



The label also shows the firmware revision present in the device (in this case 2.0.1.0) at the time of sale.
To improve performance or extend functionality, Seneca recommends updating the firmware to the latest available version (see the section dedicated to the product on www.seneca.it).

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3. FLEX TECHNOLOGY FOR PROTOCOL CHANGE

Starting from the hardware revision indicated in the following table, the KEY series devices include Flex technology.

GATEWAY	*FLEX TECHNOLOGY SUPPORTED BY HARDWARE REVISION*
Z-KEY	"G00"
R-KEY-LT	"E00"
Z-KEY-2ETH	"C00"

Flex allows you to change the combination of industrial communication protocols supported by the gateways at will from a list of available ones, the development is continuously updated, for a complete list refer to the page: https://www.seneca.it/flex/

Some examples of supported protocols are:


The gateway then becomes "universal" and compatible with Siemens or Rockwell or Schneider systems etc. without the need to purchase different hardware.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.


Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3.1. CHANGING PROTOCOLS WITH THE SENECA DISCOVERY DEVICE SOFTWARE

From revision 2.8 the Seneca Discovery Device software identifies the devices that support the “Flex” technology:

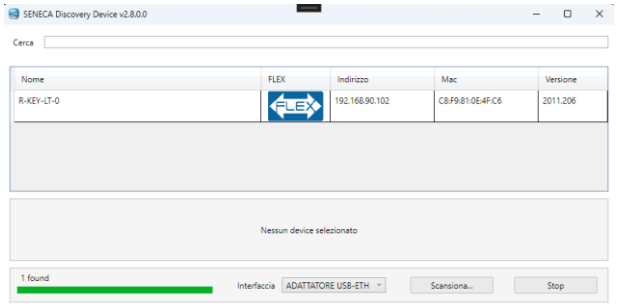

For example, in the case in the figure it is possible to press the “Change Protocol” button and select the destination protocol from those in the list:

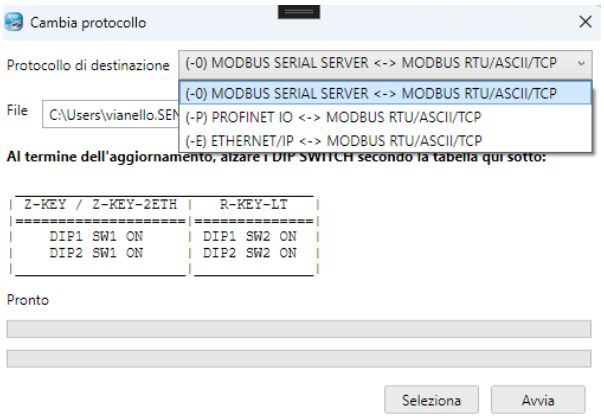

At the end of the operation, bring (only at the first power-on) the dip switches 1 and 2 to “ON” to force the device to default (see also the chapter “RESETTING THE DEVICE TO ITS FACTORY CONFIGURATION”).

Always refer to the user manual of the communication protocol installed in the device by downloading it from the Seneca website.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

4. *LED MEANING*

The devices are equipped with LEDs whose meaning is as follows:

4.1. Z-KEY-I (IEC61850) MODEL LED

LED	***STATUS***
PWR	***Steady on***: device powered and IP address set ***Flashing***: IP address not yet set ***Off***: device not powered
COM	Not used
TX1	***Flashing:*** data transmission on serial port #1 ***Off:*** no transmission on serial port #1
RX1	***Flashing:*** data reception on serial port #1 ***Steady on:*** check wiring on serial port #1 ***Off:*** no reception on serial port #1
TX2	***Flashing:*** data transmission on serial port #2 ***Off:*** no transmission on serial port #2
RX2	***Flashing:*** data reception on serial port #2 ***Steady on:*** check wiring on serial port #2 ***Off:*** no reception on serial port #2
ETH ACT (GREEN)	***Flashing:*** presence of data on ethernet port ***Steady on:*** ethernet port connected but no data present ***Off:*** check wiring of the ethernet port
ETH LNK (YELLOW)	***Steady on:*** ethernet cable connected ***Off:*** check the wiring of the ethernet port

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

4.2. R-KEY-LT-I (IEC61850) MODEL LED

LED	***STATUS***
PWR	***Steady on***: device powered and IP address set ***Flashing***: IP address not yet set ***Off***: device not powered
COM	Not used
TX	***Flashing:*** data transmission on serial port ***Off:*** no transmission on serial port
RX	***Flashing:*** data reception on serial port ***Steady on:*** check wiring on serial port ***Off:*** no reception on serial port
ETH ACT (GREEN)	***Flashing:*** presence of data on ethernet port ***Steady on:*** ethernet port connected but no data present ***Off:*** check wiring of the ethernet port
ETH LNK (YELLOW)	***Steady on:*** ethernet cable connected ***Off:*** check the wiring of the ethernet port

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

4.3. Z-KEY-2ETH-I (IEC61850) MODEL LED

LED	*STATUS*
PWR	***Steady on***: device powered and IP address set ***Flashing***: IP address not yet set ***Off***: device not powered
COM	Not used
TX1	***Flashing:*** data transmission on serial port #1 ***Off:*** no transmission on serial port #1
RX1	***Flashing:*** data reception on serial port #1 ***Steady on:*** check wiring on serial port #1 ***Off:*** no reception on serial port #1
TX2	***Flashing:*** data transmission on serial port #2 ***Off:*** no transmission on serial port #2
RX2	***Flashing:*** data reception on serial port #2 ***Steady on:*** check wiring on serial port #2 ***Off:*** no reception on serial port #2
ET1	***Flashing:*** presence of data on ethernet port #1 ***Steady on:*** ethernet port #1 connected but no data present ***Off:*** check wiring of ethernet port #1
ET2	***Flashing:*** presence of data on ethernet port #2 ***Steady on:*** ethernet port #2 connected but no data present ***Off:*** check wiring of ethernet port #2

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

5. ETHERNET PORT

The factory configuration of the Ethernet port is:

STATIC IP: 192.168.90.101
SUBNET MASK: 255.255.255.0
GATEWAY: 192.168.90.1

Multiple devices must not be inserted on the same network with the same static IP.

⚠ ATTENTION!

DO NOT CONNECT 2 OR MORE FACTORY-CONFIGURED DEVICES ON THE SAME NETWORK, OR THE DEVICE WILL NOT WORK
(CONFLICT OF IP ADDRESSES 192.168.90.101)

6. FIRMWARE UPDATE

In order to improve, add or optimize the functions of the product, Seneca releases firmware updates on the device section on the www.seneca.it website

The firmware update is performed using Seneca tools or the webserver.

⚠ ATTENTION!

NOT TO DAMAGE THE DEVICE DO NOT REMOVE THE POWER SUPPLY DURING THE FIRMWARE UPDATE OPERATION.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.


LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

7. OPERATING MODE

The Gateway allows you to operate in the following mode:
GATEWAY IEC 61850 SERVER / MODBUS RTU/TCP MASTER

7.1. GATEWAY IEC 61850 SERVER / MODBUS MASTER

This operating mode allows to connect an IEC 61850 SCADA client with Modbus RTU/ASCII Slave and/or remote TCP Server I/O devices

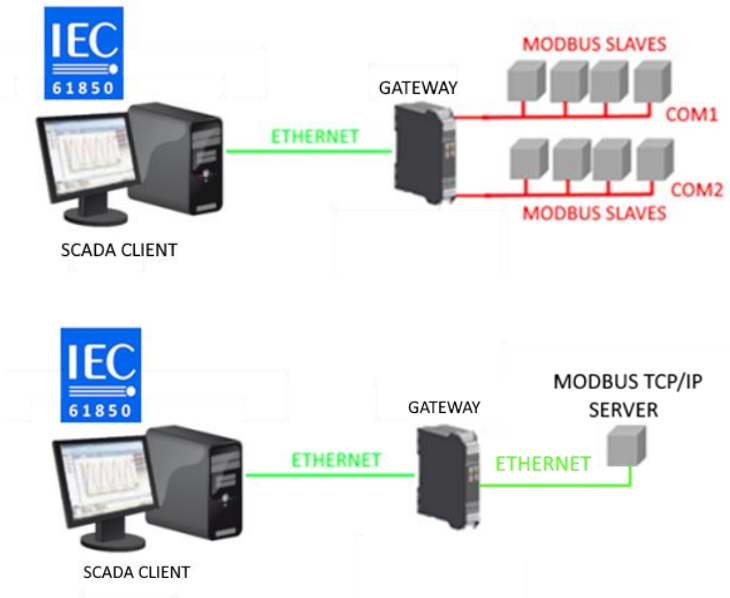

The Gateway, on the field side, works as a Modbus master / Modbus Client device and on the other side as an IEC 61850 server via Ethernet.
The Modbus requests (read or write commands) are configured in the gateway device and an ICD file is automatically generated according to the IEC 61850 standard.
Once this file is imported into the SCADA (it is also possible to search for the node) all the configured IO will be accessible without any other configuration.

In addition to the serial devices, it is also possible to connect up to 3 remote Modbus TCP-IP servers.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.


Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

8. *IEC61850 IMPLEMENTATION ON THE "KEY" SERIES GATEWAYS*

Given the complexity of the IEC61850 protocol, the "KEY" series gateways implement an IEC61850 server with some simplified features that we list:

8.1. Basic SCL structure


The basic SCL structure is constant and is represented by 3 logical nodes:

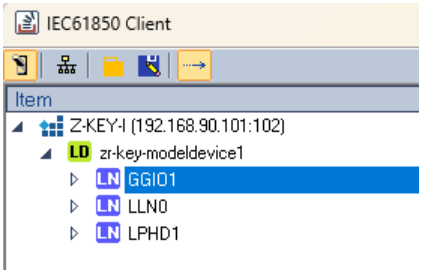

GGIO1 represents the logical Node Generic IO 1, here all the variables coming from the Modbus buses will be present.
LLN0 represents the logical node zero. Contains the data relating to the Intelligent Electronic Device (IED family KEY)
LPHD1 represents the physical logic node 1. Contains information relating to the physical device.

8.2. Modbus variables

When variables are added (reads from the Modbus protocol) these will always be added to the logic node GGIO1. For example, for the "VAR1" variable we have:

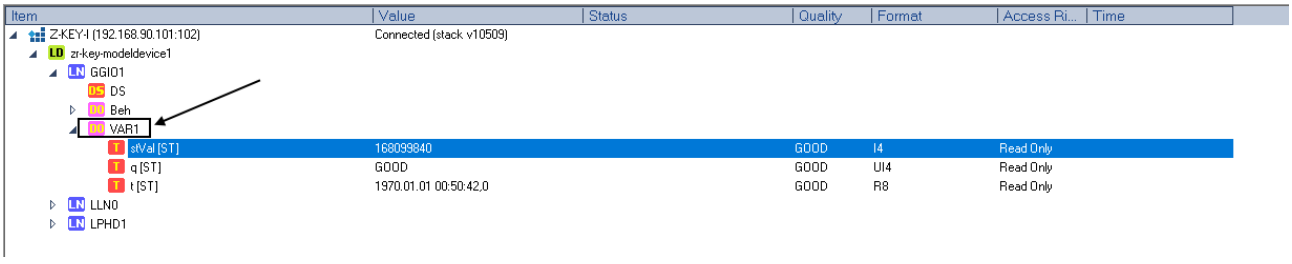

8.3. DataSet

For the Report Data Blocks it is necessary to define one or more sets of variables, this is done through the definition of the datasets.
Datasets can be used across different Report Control Blocks.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


8.4. Report Control Block (RCB) unbuffered/buffered in the SCL structure

The IEC 61850 standard defines a reporting mechanism that uses spontaneous data transmission from the server to the client. This aims to minimize the network load.
The generation and transmission of the report are controlled by the report control blocks.
A report control block is defined by its attributes, such as the assigned dataset, trigger options and optional fields. The dataset is sent directly from the server to the client in case the configured event has occurred.
The KEY series gateways support both buffered and unbuffered RCBs.

In unbuffered RCBs the data is transmitted as defined by the chosen trigger options. In case of a connection loss the data is not stored. Transmission resumes once the connection is re-established but information that may have been transmitted during the connection loss will be lost. These RCBs are ideal for managing alarms.

In buffered RCBs, however, in the event of a connection interruption, the data is stored in a circular buffer. As soon as the connection is re-established, the buffered information is transmitted in chronological order.
These RCBs are ideal for managing measurements.

When Report Data Blocks are defined they can be associated with GGIO1 or LLN0:

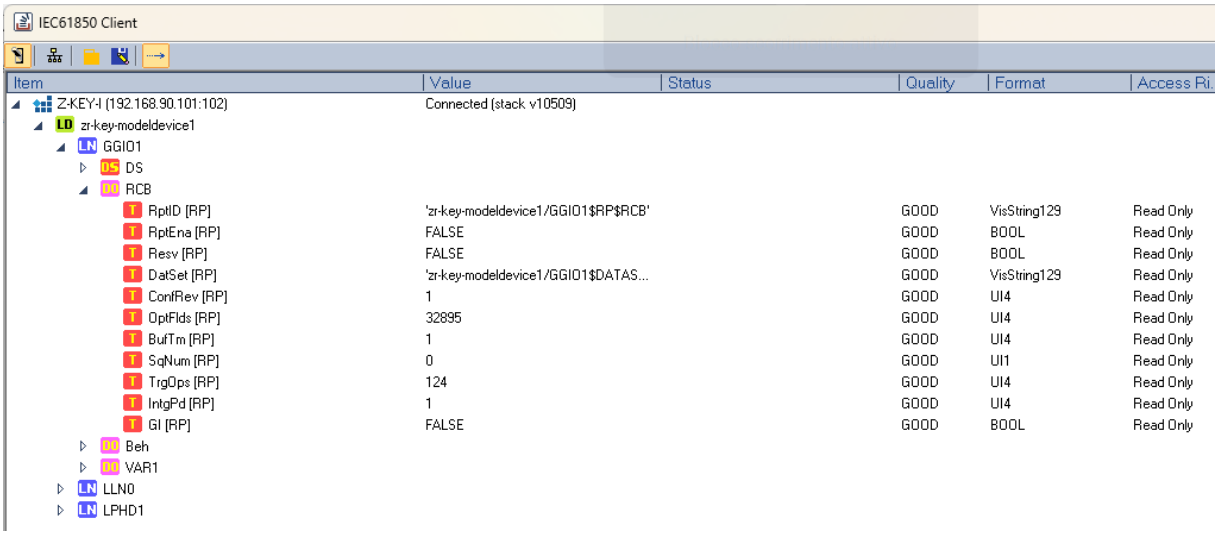

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

9. GATEWAY CONFIGURATION

9.1. GATEWAY CONFIGURATION WITH THE WEBSERVER FOR THE "COPADATA IEC61850 CLIENT™" CLIENT

The COPADATA "IEC61850 Client" software will be used as IEC 61850 client for Windows.
For more information on the client software, refer to:

https://www.copadata.com

The purpose is to configure the gateway so that it can read a register coming from the serial modbus RTU protocol from a 61850 client.

We configure the Gateway via the webserver, first we activate the webserver (by default the device is in IEC61850 mode), we hold down the side button until the device restarts.
At this point the PWR LED starts to flash to indicate the operating mode as a webserver for the configuration.
The default address of the webserver is:

http://192.168.90.101

user: admin
password: admin

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

First, let's configure the Ethernet and serial parameters:

	CURRENT	UPDATED
DHCP	Disabled	Disabled
STATIC IP	192.168.90.101	192.168.90.101
STATIC IP MASK	255.255.255.0	255.255.255.0
STATIC GATEWAY	192.168.90.1	192.168.90.1
TCP/IP PORT	502	502
TCP/IP TIMEOUT [ms]	512	512
PORT#1 MODBUS PROTOCOL	RTU	RTU
PORT#2 MODBUS PROTOCOL	RTU	RTU
PORT#1 BAUDRATE	38400	38400
PORT#1 DATA BITS	8	8
PORT#1 PARITY	None	None
PORT#1 STOP BITS	1	1
PORT#1 TIMEOUT [ms]	500	500
PORT#1 WRITING RETRIES	3	3
PORT#2 BAUDRATE	38400	38400
PORT#2 DATA BITS	8	8
PORT#2 PARITY	None	None
PORT#2 STOP BITS	1	1
PORT#2 TIMEOUT [ms]	500	500
PORT#2 WRITING RETRIES	3	3
WEB SERVER PORT	80	80
WEB SERVER AUTHENTICATION USER NAME	admin	admin
WEB SERVER AUTHENTICATION USER PASSWORD	admin	admin
IP CHANGE FROM DISCOVERY	Enabled	Enabled
TLS	Disabled	Disabled
MODBUS TCP-IP CLIENT	ENABLED	ENABLED
MODBUS TCP-IP SERVER#1	ENABLED	ENABLED
SERVER#1 TCP/IP PORT	502	502
SERVER#1 TCP/IP ADDRESS	192.168.90.81	192.168.90.81
MODBUS TCP-IP SERVER#2	DISABLED	DISABLED
SERVER#2 TCP/IP PORT	502	502
SERVER#2 TCP/IP ADDRESS		
MODBUS TCP-IP SERVER#3	DISABLED	DISABLED
SERVER#3 TCP/IP PORT	502	502
SERVER#3 TCP/IP ADDRESS		
MODBUS TCP-IP CLIENT TIMEOUT [ms]	5000	5000
MODBUS TCP-IP CLIENT WRITING ATTEMPTS	3	3
SERVER AFTER FAIL DELAY [s]	60	60
STOP MODBUS READING WHEN NO IEC61850 CONNECTION	Disabled	Disabled
SYNC CLOCK WITH TIME INTERNET	ENABLED	ENABLED
NTP SERVER 1 ADDRESS	193.204.114.232	193.204.114.232
NTP SERVER 2 ADDRESS	0.0.0.0	0.0.0.0
GMT	0	0
IEC MODEL NAME	zr-key-model	zr-key-model
IEC DEVICE NAME	device1	device1
IEC61850 SERVER TCP/IP PORT	102	102


ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

N.B. the protocol requires the use of UTC time to send the timestamp, we therefore recommend setting an NTP server and GMT = 0.
The date/time after a reboot will be synchronized by the NTP server, it is therefore necessary that the device has the ability to access the server.
IEC MODEL NAME and IEC DEVICE NAME are important in order to configure the IED and the logical device.

Now let's create the Modbus master requests (commands).
Let's enter the Setup Modbus Commands/Tags page:


Let's read 10 holding registers from 40001 and 40010 (offset 0 and 9) from the device with station address 1, press the "APPLY" button.

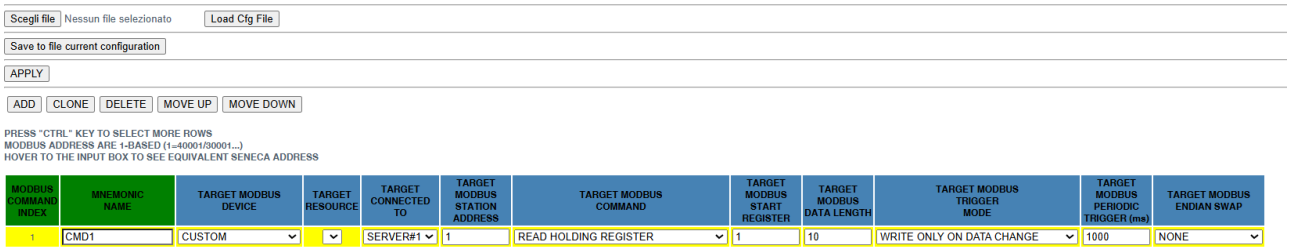


ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Now the read bytes are updated in the internal memory of the gateway, let's go to the I/O Mapping page:

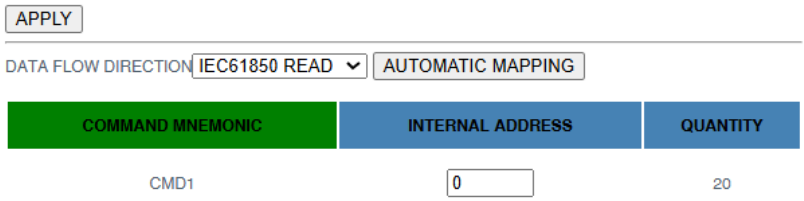

At this point we define an IEC variable associated with the first 2 bytes acquired from Modbus:

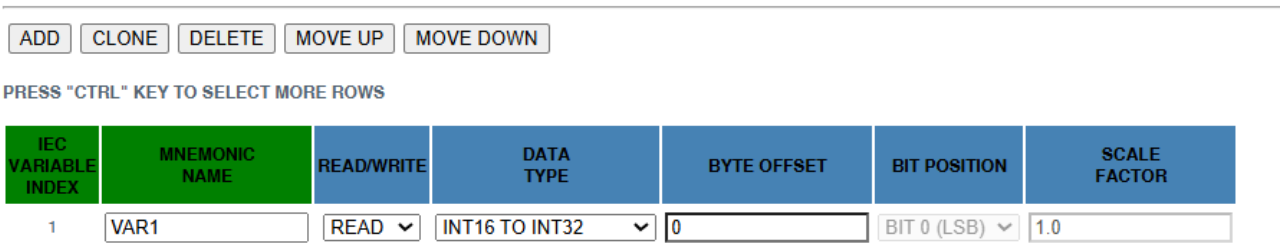


N.B. mnemonic name represents the Data Object with which the variable will be exposed in the 61850 protocol.
The 2 byte Modbus conversion must be brought to 32 bits since the 16-bit data type does not exist. Scaling is only available in the case of Float data type. It is also possible to discretize the single bit of the word in the boolean data type.
Three data types are managed:
INS (32-bit integer)
SPS (Boolean)
MV(32-BIT FLOAT)


We confirm with APPLY.
If we go to the “Status” section we will find the first 20 bytes in memory with the values read from Modbus and the IEC variable we have defined (linked to the first 2 bytes):

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

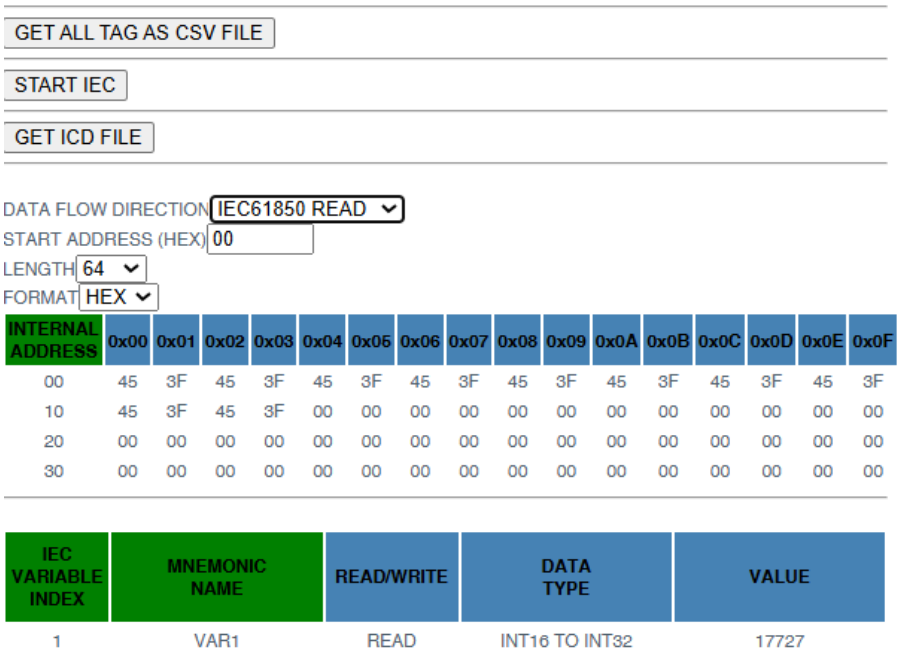


Let's now define a Dataset and then an associated Report Control Block.
Let's start by defining a Data Set from the “SETUP IEC DATASET” section.
Let's create a Dataset on the logical node LLN0 and select GGIO1.VAR1[ST] to add the variable VAR1 and the subattributes:

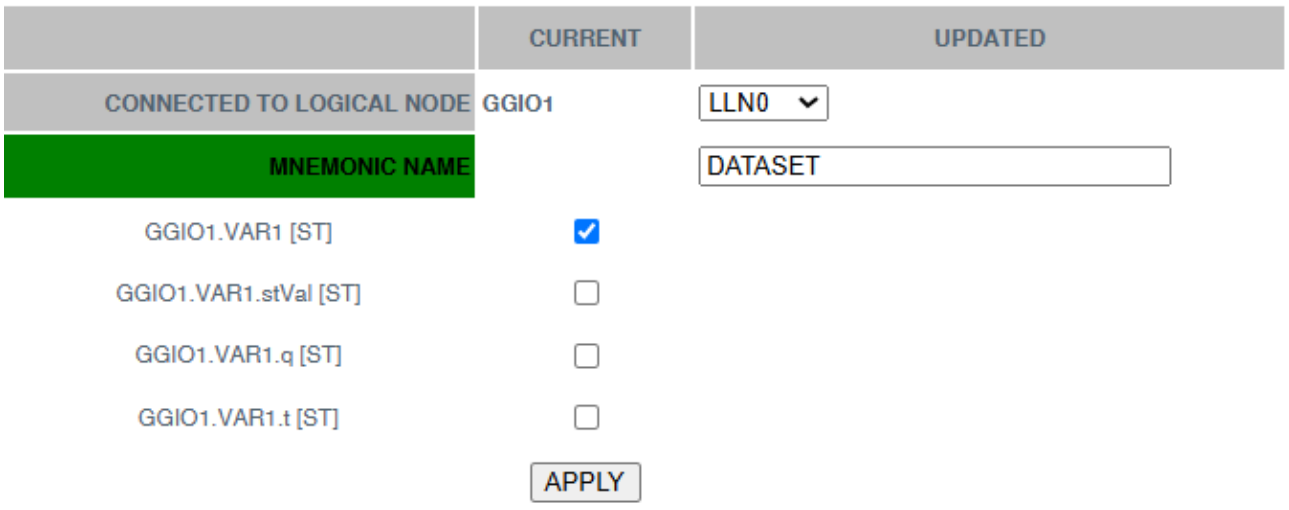


ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Let's press “APPLY” and the Dataset is created:

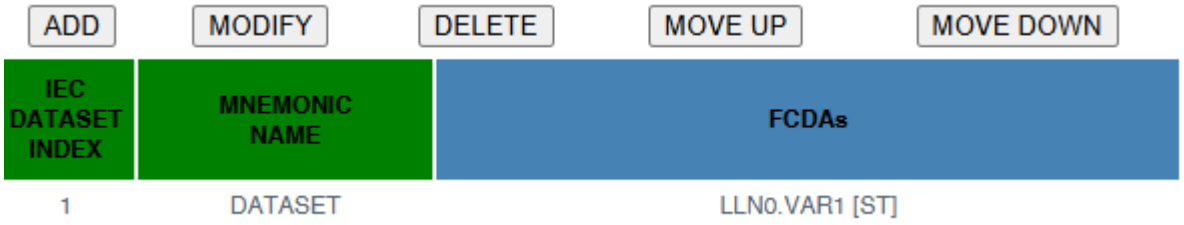

Let's now go to the “SETUP IEC REPORT CONTROL BLOCK” section and press the ADD button:

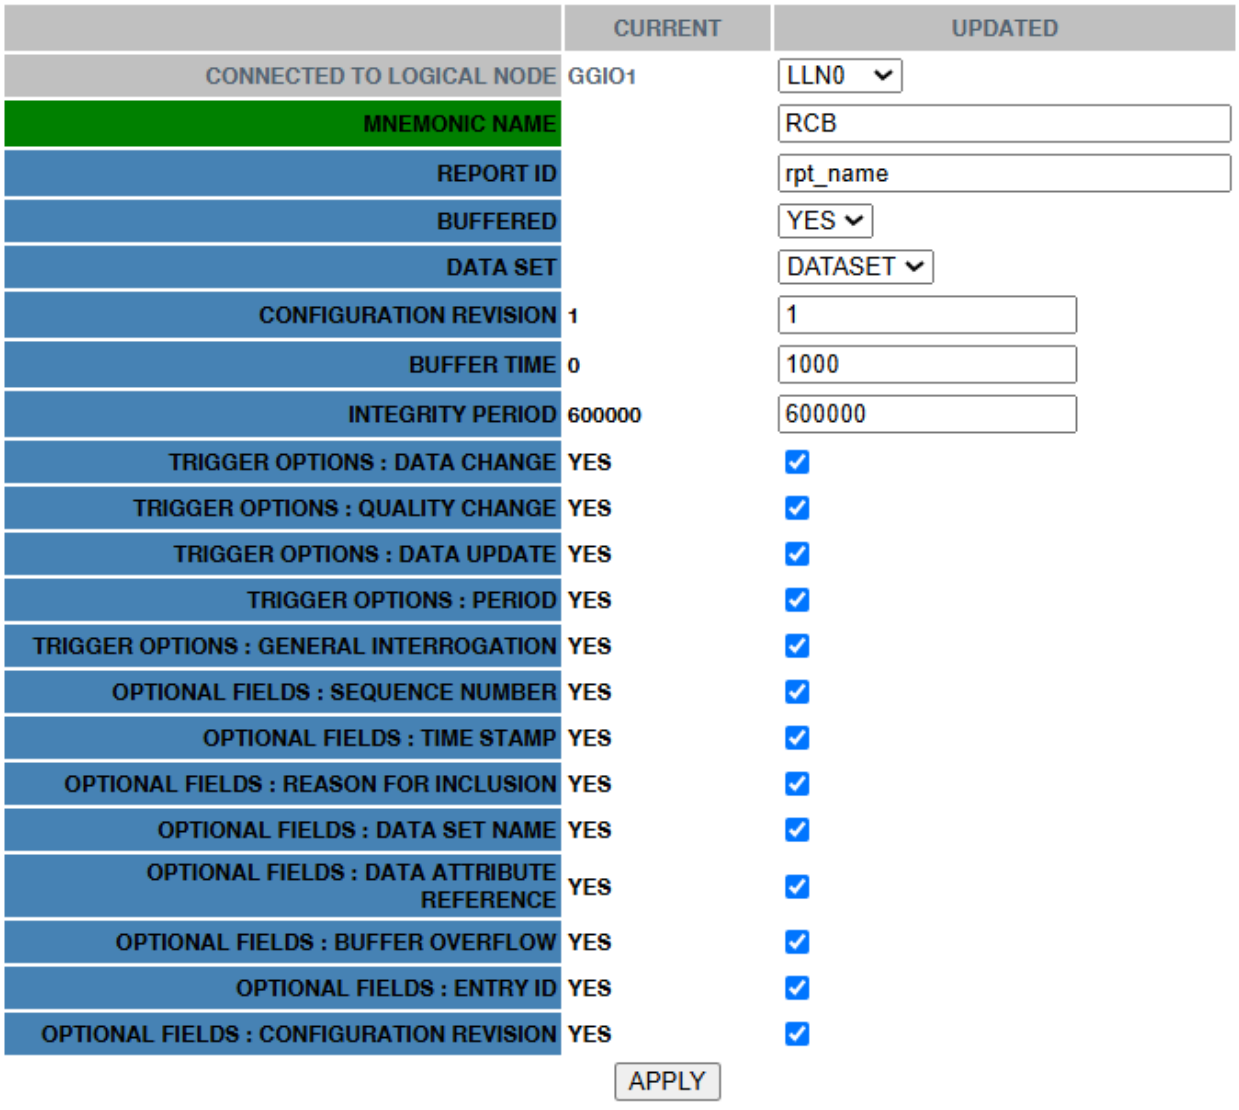


We have selected the logical Node where we defined the Dataset, we define it buffered with a buffer time of 1000 ms.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.


Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Let's confirm with “APPLY” and we obtain our buffered Report Control Block:

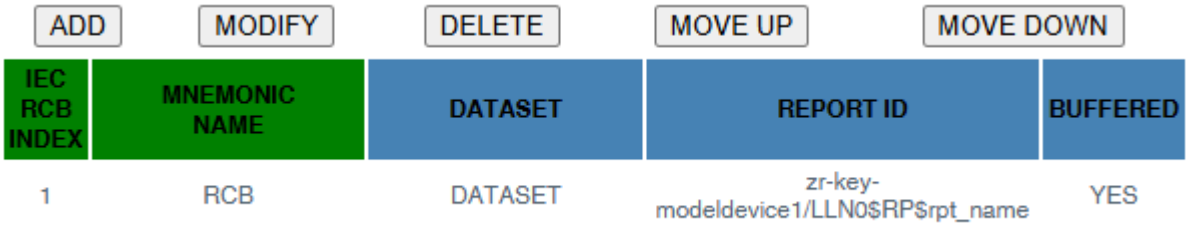

Let's now go back to the “STATUS” section and press the “Start IEC” button, at this point the device restarts in IEC61850 mode (the webserver is disabled), the operation could also be obtained by holding down the side button.


Now let's open the 61850 client and set up the connection to our KEY-I and import the RCB:

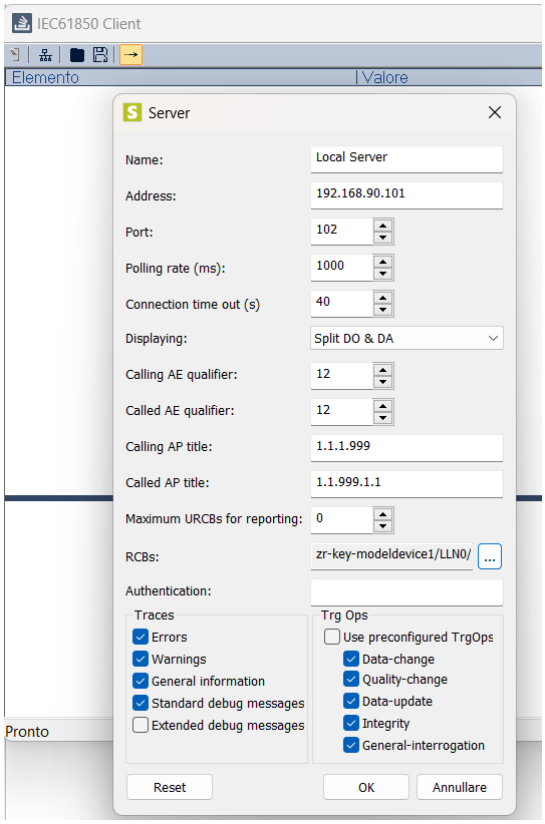

Let's start the client and note both the IEC variable (VAR1) and the RCB:

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

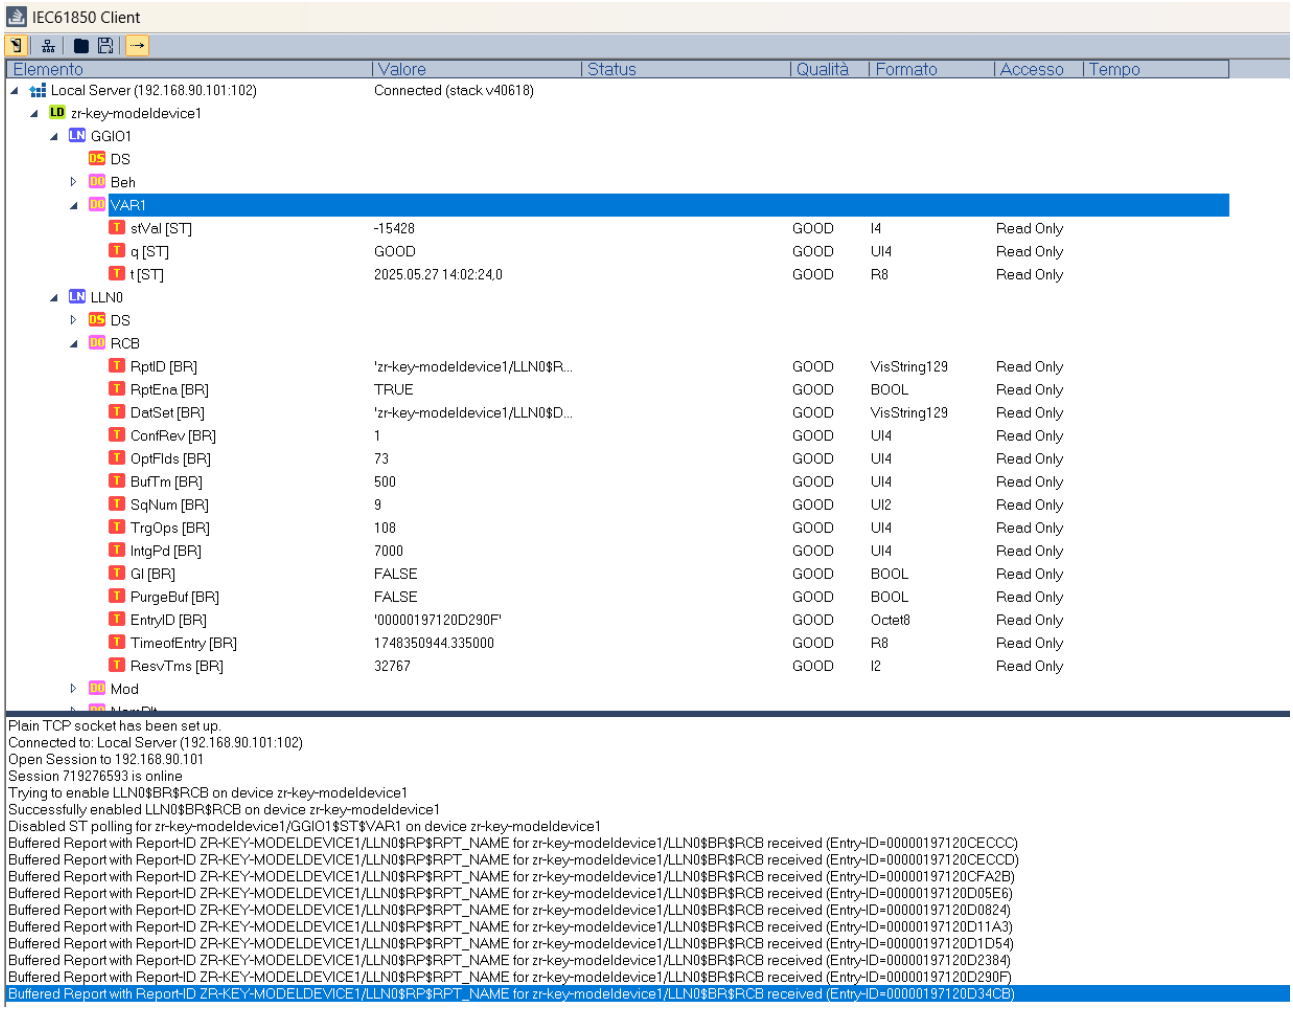

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10. GATEWAY WEBSERVERS

10.1. WEBSERVER DEI GATEWAY "-I"

10.1.1. WEBSERVER MODE AND IEC61850 MODE

The device is normally in Webserver mode.

To access the internal webserver, you must put the device in Webserver mode by pressing the button following the procedure:

10.1.2. MANUAL PROCEDURE FOR SWITCHING FROM IEC61850 MODE TO WEBSERVER MODE AND VICE VERSA

To force webserver mode:

1) Turn on the device
2) Keep the PS1 button pressed until all LEDs turn off
3) Release the button
4) The device restarts and the "PWR" led flash slowly to indicate webserver mode

To force IEC 61850 mode:

1) Turn on the device
2) Keep the PS1 button pressed until all LEDs turn off
3) Release the button
   The device restarts and the "PWR" led flash slowly to indicate IEC 61850 mode

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.


LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.3. STEP BY STEP GUIDE FOR THE FIRST ACCESS TO THE WEBSERVER

STEP 1: POWER THE DEVICE AND CONNECT THE ETHERNET PORT, PUT THE DEVICE IN WEBSERVER MODE

SENECA DISCOVERY DEVICE SOFTWARE STEP 2

If you need to change the IP address of the device (default 192.168.90.101), launch the Seneca Discovery Device software and perform the SCAN, select the device and press the "Assign IP" button, set a configuration compatible with your PC, for example:

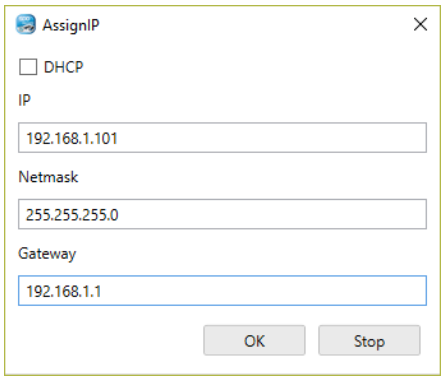

Confirm with OK. Now the device can be reached via Ethernet from your PC.

STEP 3 ACCESS TO THE CONFIGURATION WEBSERVER

ENTER your access credentials:
user: admin
password: admin

⚠ ATTENTION!

THE WEB BROWSERS WHICH HAVE BEEN TESTED FOR COMPATIBILITY WITH THE DEVICE WEBSERVER ARE:
MOZILLA FIREFOX AND GOOGLE CHROME.
THEREFORE, THE OPERATION WITH OTHER BROWSERS IS NOT GUARANTEED

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4. WEBSERVER DEVICE CONFIGURATION

For further information on the access to the webserver of a new device, please refer to chapter 10.1.3.

⚠ ATTENTION!

THE WEB BROWSERS WHICH HAVE BEEN TESTED FOR COMPATIBILITY WITH THE DEVICE WEBSERVER ARE:
MOZILLA FIREFOX AND GOOGLE CHROME.
THEREFORE, THE OPERATION WITH OTHER BROWSERS IS NOT GUARANTEED

⚠ ATTENTION!

AFTER THE FIRST ACCESS CHANGE USER NAME AND PASSWORD IN ORDER TO PREVENT ACCESS TO THE DEVICE TO UNAUTHORIZED PEOPLE.

⚠ ATTENTION!

IF THE PARAMETERS TO ACCESS THE WEBSERVER HAVE BEEN LOST, TO ACCESS IT, IT IS NECESSARY TO GO THROUGH THE PROCEDURE TO RESET THE FACTORY-SET CONFIGURATION

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4.1. WEBSERVER SECTIONS

The Webserver is divided into pages (sections) representing the various gateway functions:

Status
It is the section that displays the values of Modbus requests in real time.

Setup
This is the section that allows the basic configuration of the device, it also allows you to export or import a configuration.

Setup Modbus Commands / Tags
It is the section that allows you to add/modify the Modbus commands of the Modbus devices connected to the gateway.

I/O Mapping
This is the section that allows you to remap the bytes relating to the data coming from the Modbus protocol.

Setup IEC Variables
This is the section that allows you to create IEC variables starting from the acquisitions of Modbus commands.

Setup IEC Dataset
This is the section that allows you to create datasets to be used in Report Control Blocks.

Setup IEC Report Control Block
This is the section that allows you to create Report Control Blocks.

Firmware Update
This is the section that allows you to update the device firmware.

Certificate Setup
This is the section that allows you to manage X509 certificates

Serial Traffic Monitor
It allows to analyse the ModBUS frames of the serials.


UTC Time Setup
This allows you to set the device date/time

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4.2. "STATUS" SECTION

The Status section displays the status of the values acquired from modbus in the memory:

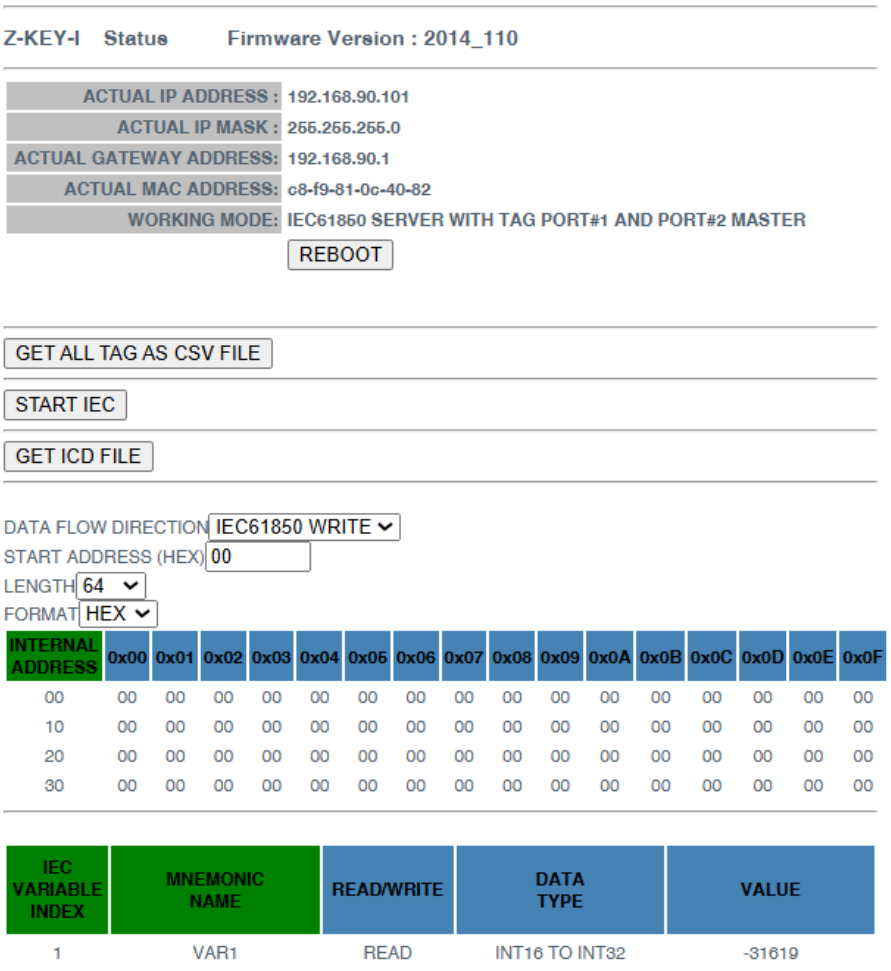

There are two types of memories: that of the read-only variables and that of the write-only variables (supported according to ICD standard edition 1,0).

GET ICD FILE allows you to export the configuration to be imported into an IEC61850 client that supports the ICD format.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4.3. "SETUP" SECTION

DHCP (ETH) (default: Disabled)
Sets the DHCP client to get an IP address automatically.

STATIC IP* (default: 192.168.90.101*)
Sets the device static address. Careful not to enter devices with the same IP address into the same network.

STATIC IP MASK (default: 255.255.255.0)
Sets the mask for the IP network.

STATIC GATEWAY (default: 192.168.90.1)
Sets the gateway address.

TCP-IP PORT (default: 502)
Sets the communication port for the Modbus TCP-IP client protocol.

TCP-IP TIMEOUT [ms] (default 512 ms)
Sets the waiting time for a request to be considered in timeout.

PORT #1 MODBUS PROTOCOL (default RTU)
Sets the protocol on the serial between Modbus RTU or Modbus ASCII

PORT #2 MODBUS PROTOCOL (default RTU)
Sets the protocol on the serial between Modbus RTU or Modbus ASCII

PORT #1 BAUDRATE (default: 38400 baud)
Selects the communication speed of the COM #1 serial port

PORT #1 DATA BITS (default: 38400 baud)
Selects the communication speed of the COM #1 serial port

PORT #1 PARITY (default: None)
Sets the parity for the COM #1 serial communication port.

PORT #1 STOP BIT (default: 1)
Sets the number of stop bits for the COM #1 serial communication port.

PORT #1 TIMEOUT [ms]
Sets the wait time before defining fail.

PORT #1 WRITING RETRIES (default: 3)

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Selects the number of writing attempts to be made on a serial slave before returning an error.

PORT #1 MAX READ NUM
Sets the maximum number of simultaneous serial reading ModBUS registers, the firmware will use this value to optimize the ModBUS readings.

PORT #1 MAX WRITE NUM
Sets the maximum number of simultaneous writing ModBUS registers of the serial, the firmware will use this value to optimize the ModBUS writings.

PORT #2 BAUDRATE (default: 38400 baud) (only for Z-KEY-I and Z-KEY-2ETH-I)
Selects the communication speed of the COM #2 serial port

PORT #2 DATA BITS (default: 38400 baud) (only for Z-KEY-I and Z-KEY-2ETH-I)
Selects the communication speed of the COM #2 serial port

PORT #2 PARITY (default: None) (only for Z-KEY-I and Z-KEY-2ETH-I)
Sets the parity for the COM #2 serial communication port.

PORT #2 STOP BIT (default: 1) (only for Z-KEY-I and Z-KEY-2ETH-I)
Sets the number of stop bits for the COM #2 serial communication port.

PORT# 2 TIMEOUT [ms] (only for Z-KEY-I and Z-KEY-2ETH-I)
Sets the wait time before defining fail.

PORT #2 WRITING RETRIES (default: 3) (only for Z-KEY-I and Z-KEY-2ETH-I)
Selects the number of writing attempts to be made on a serial slave before returning an error.

PORT #2 MAX READ NUM (only for Z-KEY-I and Z-KEY-2ETH-I)
Sets the maximum number of simultaneous reading ModBUS registers of the remote TCP-IP Modbus server, the firmware will use this value to optimize the ModBUS readings.

PORT #2 MAX WRITE NUM (only for Z-KEY-I and Z-KEY-2ETH-I)
Sets the maximum number of simultaneous writing ModBUS registers of the serial, the firmware will use this value to optimize the ModBUS writings.

WEB SERVER AUTHENTICATION USER NAME (default: admin)
Sets the username to access the webserver.

WEB SERVER PASSWORD (default: admin)
Sets the password to access the webserver and to read/write the configuration (if enabled).

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

WEB SERVER PORT (default: 80)
Sets the communication port for the web server.

IP CHANGE FROM DISCOVERY (default: Enabled)
Selects whether or not the device accepts the IP address change from the Seneca Discovery Device software.

TLS (default: Disabled)
Enables or disables cryptographic protocols via TLS.

MODBUS TCP-IP CLIENT
Enables or not the TCP-IP client Modbus

MODBUS TCP-IP SERVER#1…3 PORT
Sets the port for the max 3 remote TCP-IP Modbus servers

MODBUS TCP-IP SERVER#1…3 ADDRESS
Sets the IP address for the max 3 remote TCP-IP Modbus servers

MODBUS TCP-IP CLIENT TIMEOUT [ms]
Sets the timeout for remote TCP-IP Modbus servers

MODBUS TCP-IP CLIENT WRITING ATTEMPTS
Selects the number of writing attempts to be made on a remote TCP-IP Modbus server before returning an error and activating the quarantine.

MODBUS TCP-IP CLIENT MAX READ NUM
Sets the maximum number of simultaneous reading ModBUS registers of the remote TCP-IP Modbus server, the firmware will use this value to optimize the ModBUS readings.

MODBUS TCP-IP CLIENT MAX WRITE NUM
Sets the maximum number of simultaneous writing ModBUS registers of the remote TCP-IP Modbus server, the firmware will use this value to optimize the ModBUS writings.

SERVER AFTER FAIL DELAY
Sets the number of quarantine seconds after a tag has been declared in fail (i.e. these tags are no longer considered) before being interrogated again.

STOP MODBUS READING WHEN NO IEC61850 CONNECTION
If active, it allows to stop the modbus communication when the communication with the IEC61850 client is lost. This allows to trigger any timeouts present in the modbus slave/server devices.

SYNC CLOCK WITH TIME INTERNET

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Allows you to enable date/time updating via connection to NTP servers (RFC 5905).

> ***⚠ ATTENTION!***
>
> ***AT EACH RESTART THE DEVICE MUST BE ABLE TO RETRIEVE THE DATE/TIME FROM AN NTP SERVER OTHERWISE THIS WILL BE SET TO 1/1/1970 0:00***

NTP SERVER 1 ADDRESS
This is the IP address of the first NTP server (for example 193.204.114.232 for INRIM's NTP)

NTP SERVER 2 ADDRESS
This is the IP address of the second NTP server (in case the first one does not respond)

GMT
Sets the offset from Greenwich Mean Time (for example for Italy GMT=+1 when daylight saving time is not in effect)

IEC MODEL NAME
Sets the model name for the IEC protocol

IEC DEVICE NAME
Sets the device name for the IEC protocol

IEC61850 SERVER TCP/IP PORT
Sets the TCP-IP communication port of the IEC61850 protocol

In addition, a configuration can be exported / imported via the webserver.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


10.1.4.3.1. SAVING A CONFIGURATION ON A FILE

A configuration that includes:

CONFIGURATION
TAGS/COMMANDS

It can be saved to a file this way:

Go to the Setup section and select the file to save, press the "Save config" button

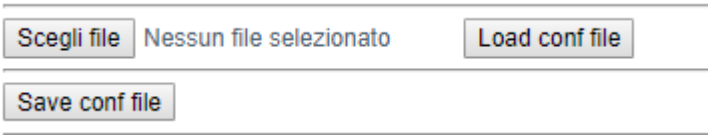

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


10.1.4.3.2. IMPORTING A CONFIGURATION FROM A FILE

A configuration that includes:

CONFIGURATION
TAGS/COMMANDS

It can be imported from a file this way:

Go to the Setup section and select the file to load, press the "Load config" button

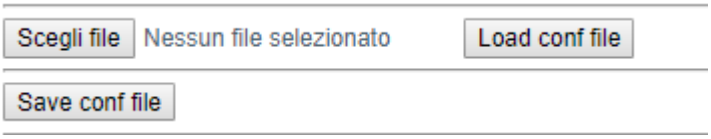

10.1.4.4. "SETUP COMMANDS/TAGS" SECTION

In this section you can add, edit or delete a Modbus command.

Using the ADD button you can add a new command.
Using the CLONE button it is possible to clone a command.
Using the DEL button it is possible to delete an existing command.

MNEMONIC NAME
It is the identifying name of the command

TARGET MODBUS DEVICE
It represents the Seneca Modbus device selected from those available in the database.
In the case of a non-Seneca device or for advanced configurations, select CUSTOM.

TARGET RESOURCE
It represents the Seneca device variable you want to add.

TARGET CONNECTED TO
It selects the serial to be used for Modbus serial communication for the specified TAG.

TARGET MODBUS STATION ADDRESS
It selects the station address to use for the command.

TARGET MODBUS START REGISTER
It represents the starting Modbus address of the command (in the case of a Seneca device it is filled in automatically).

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

TARGET MODBUS REQUEST TYPE

It represents the type of Modbus command to use (Read Holding Register, Coil etc.).
In the case of a Seneca device it is filled in automatically.

TARGET REGISTER DATA LENGTH

Allows you to set how many Modbus registers are required in the command.

TARGET MODBUS WRITE PERIODIC TRIGGER [ms]

Represents the time interval of execution of the command

ENDIAN SWAP

Allows you to swap a register read by Modbus, i.e.:
NONE: no swap
BYTE: shifts the high byte with low byte (for example Modbus reading 0xAABB will be converted to 0xBBAA)
WORD: In the case of a data type greater than a Modbus register (e.g. single precision Floating Point registers) it allows you to set which word (register) to use as the most significant part, for example:
Register 1 = 0xAABB
Register 2 = 0xCCDD
will become a single value 0xAABBCCDD if the parameter is NONE, otherwise 0xCCDDAABB if this parameter is active
BYTE AND WORD: as in the previous case but there will also be a byte swap, for example:
Register 1 = 0xAABB
Register 2 = 0xCCDD
Will become 0xDDCCBBAA

10.1.4.5. "I/O MAPPING" SECTION

Allows you to move the contents of the bytes of the read and write buffers.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4.1. "SETUP IEC VARIABLES" SECTION

Allows you to define an IEC variable from the read or write buffer

MNEMONIC NAME

This is the name of the variable that will appear in the IEC61850 client

READ/WRITE

Selects whether the variable should be created from the read or write buffer

DATA TYPE

Represents the data type of the variable, the device can also convert the data type on the IEC61850 protocol:
BIT (SPS)-> 1 bit buffer size
INT16 TO INT32 (INS) -> 2 byte buffer size (converted to 4 bytes in the IEC61850 protocol)
UINT16 TO INT32 (INS) -> 2 byte buffer size (converted to 4 bytes in the IEC61850 protocol)
INT32 (INS) -> 4 byte buffer size
INT16 TO FLOAT32 (MV)-> 2 byte buffer size (converted to 4 bytes in the IEC61850 protocol)
UINT16 TO FLOAT32 (MV)-> 2 byte buffer size (converted to 4 bytes in the IEC61850 protocol)
INT32 TO FLOAT32 (MV)-> 4 byte buffer size
FLOAT 32 (MV)-> 4 byte buffer size

BYTE OFFSET

Represents the starting byte of the read or write buffer variable. The amount of bytes to use is defined by the data type

SCALE FACTOR

It is the floating point coefficient that multiplies the Modbus value (for example, if you set 0.1, the Modbus reading of 10 will be converted to 1 on IEC61850).

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


10.1.4.1. "SETUP IEC DATASET" SECTION

Allows you to set datasets by selecting the variables to enter.

CONNECTED TO LOGICAL NODE
Represents the logical node to which the Dataset is connected

MNEMONIC NAME
Represents the name of the Dataset

Then select the variables to associate:

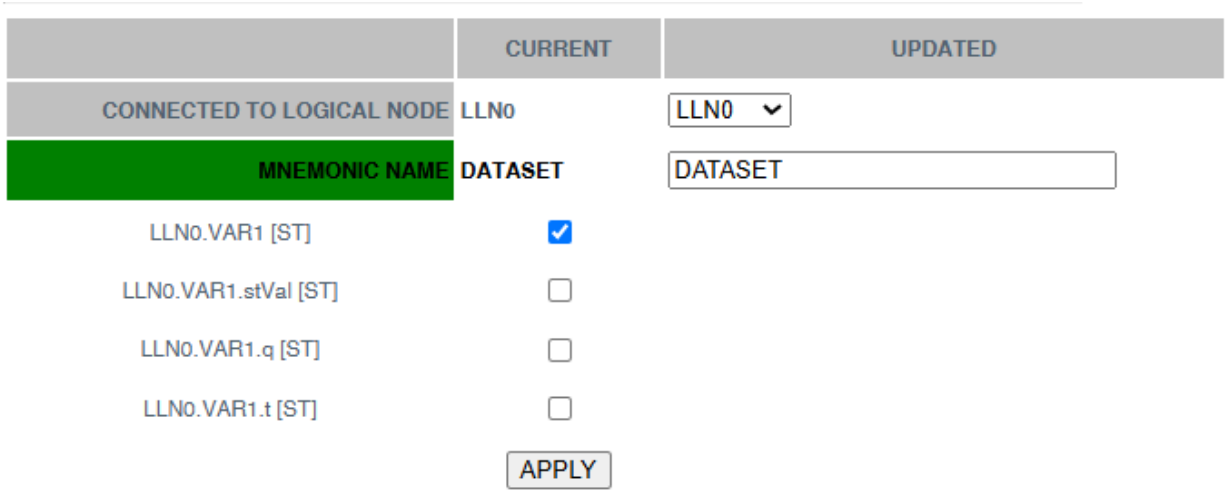

10.1.4.2. "SETUP IEC REPORT CONTROL BLOCK" SECTION

Allows you to set the configuration of the Report Control Blocks and of the relevant Dataset.

CONNECTED TO LOGICAL NODE
Specifies the Logical Node (LN) to which the RCB is associated.
Typical values: LLN0 (Logical Node zero, the root node of the device instance).

MNEMONIC NAME
Mnemonic name of the RCB block, used as an identifying reference.
Example: RCB

REPORT ID
Unique identifier of the submitted report, used by the client to distinguish report sources.
Example: rpt_name

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

BUFFERED
Indicates whether the report is buffered (YES) or unbuffered (NO).
Buffered: Reports are temporarily stored if the client is unavailable.
Unbuffered: Reports are sent only if the client is connected.

DATA SET
Selection of the DataSet containing the references to the data that will be included in the reports.
Values: Default list of available DataSets.

CONFIGURATION REVISION
Revision number of the report configuration. Increased each time the dataset content changes.
Purpose: Ensure that clients and servers are in sync.

BUFFER TIME (ms)
Minimum delay between two successive reports, even if multiple events occur.
Unit: milliseconds.
Example: 1000 (1 second)

INTEGRITY PERIOD (ms)
Integrity period: forced sending of the report even if there are no changes.
Unit: milliseconds.
Example: 600000 (10 minutes)

Trigger Options
They determine the conditions that cause a report to be sent:
DATA CHANGE: the report is sent when the value of a data changes**.**
QUALITY CHANGE: the report is sent if the quality changes (e.g. 'good', 'invalid').
DATA UPDATE: The report is sent when the data is updated, even if it does not change.
PERIOD: report sent periodically, according to the Integrity Period.
GENERAL INTERROGATION: allows the client to request immediate sending of a report.

Optional Fields
These are optional fields included in the reports, useful for improving traceability and diagnostics:
SEQUENCE NUMBER: report progressive number.
TIME STAMP: time and date of the event or update**.**
REASON FOR INCLUSION: reason for the report trigger (e.g. data change, GI...).
DATA SET NAME: name of the included DataSet.
DATA ATTRIBUTE REFERENCE: complete data references (e.g. LD0/MMXU1.Vol.instMag.i).
BUFFER OVERFLOW: indicates whether data was lost due to buffer overflow.
ENTRY ID: unique identifier of the event within the buffer.
CONFIGURATION REVISION: version of the configuration used at the time of the report.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

	CURRENT	UPDATED
CONNECTED TO LOGICAL NODE	LLN0	LLN0
MNEMONIC NAME	RCB	RCB
REPORT ID	rpt_name	rpt_name
BUFFERED	YES	YES
DATA SET		DATASET
CONFIGURATION REVISION	1	1
BUFFER TIME	1000	1000
INTEGRITY PERIOD	600000	600000
TRIGGER OPTIONS : DATA CHANGE	YES	☑
TRIGGER OPTIONS : QUALITY CHANGE	YES	☑
TRIGGER OPTIONS : DATA UPDATE	YES	☑
TRIGGER OPTIONS : PERIOD	YES	☑
TRIGGER OPTIONS : GENERAL INTERROGATION	YES	☑
OPTIONAL FIELDS : SEQUENCE NUMBER	YES	☑
OPTIONAL FIELDS : TIME STAMP	YES	☑
OPTIONAL FIELDS : REASON FOR INCLUSION	YES	☑
OPTIONAL FIELDS : DATA SET NAME	YES	☑
OPTIONAL FIELDS : DATA ATTRIBUTE REFERENCE	YES	☑
OPTIONAL FIELDS : BUFFER OVERFLOW	YES	☑
OPTIONAL FIELDS : ENTRY ID	YES	☑
OPTIONAL FIELDS : CONFIGURATION REVISION	YES	☑

APPLY

10.1.4.1. "FIRMWARE UPDATE" SECTION

In order to improve, add, optimize the functions of the product, Seneca releases firmware updates on the device section on the www.seneca.it website

⚠ ATTENTION!

NOT TO DAMAGE THE DEVICE DO NOT REMOVE THE POWER SUPPLY DURING THE FIRMWARE UPDATE OPERATION.

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

10.1.4.1. "CERTIFICATE SETUP" SECTION

This section allows you to send or delete a certificate and/or the private key of the device.
Up to 5 certificates are supported for clients.
The used format is PEM.

10.1.4.2. SERIAL "SERIAL TRAFFIC MONITOR"

Allows you to view the serial packets that are in transit.

10.1.4.1. LOCAL TIME SETUP

This allows you to set the date/time manually.

> ***ATTENTION!***
> ***IF AN NTP SERVER IS NOT SET, THE DEVICE WILL HAVE THE DATE/TIME 1/1/1970 0:00 WHEN IT RESTARTS***

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

11. SUPPORTED MODBUS COMMUNICATION PROTOCOLS

The Modbus communication protocols supported are:

- Modbus RTU/ASCII master (from #1 and #2 serial ports)
- Modbus RTU/ASCII slave (from #1 and #2 serial ports)
- Modbus TCP-IP Client (from the Ethernet port) up to 3 remote TCP-IP Modbus Servers

For more information on these protocols, see the website:
http://www.modbus.org/specs.php.

11.1. SUPPORTED MODBUS FUNCTION CODES

The following Modbus functions are supported:

- Read Coils (function 1)
- Read Discrete Inputs (function 2)
- Read Holding Registers (function 3)
- Read Input Registers (function 4)
- Write Single Coil (function 5)
- Write Single Register (function 6)
- Write multiple Coils (function 15)
- Write Multiple Registers (function 16)

⚠ ATTENTION!

All 32-bit variables are contained in 2 consecutive Modbus registers

All 64-bit variables are contained in 4 consecutive Modbus registers

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

12. RESETTING THE DEVICE TO ITS FACTORY CONFIGURATION

The factory configuration resets all parameters to default.

To reset the device to the factory configuration it is necessary to follow the procedure below:

Z-KEY-I / Z-KEY-2ETH-I:

1) Remove power from the device
2) Turn dip switches 1 and 2 to ON
3) Power up the device and wait at least 10 seconds
4) Remove power from the device
5) Turn dip switches 1 and 2 to OFF
6) At the next restart the device will have loaded the factory configuration

R-KEY-LT-I:

1) Remove power from the device
2) Set dip switches 1 and 2 of SW2 to ON
3) Power up the device and wait at least 10 seconds
4) Remove power from the device
5) Turn 2 SW2 dip switches to OFF.
6) At the next restart the device will have loaded the factory configuration

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

13. INFORMATION ABOUT MODBUS REGISTERS

The following abbreviations are used in the following chapter:

MS	Most Significant
LS	Least Significant
MSBIT	Most Significant Bit
LSBIT	Least Significant Bit
MMSW	“Most” Most Significant Word (16bit)
MSW	Most Significant Word (16bit)
LSW	Least Significant Word (16bit)
LLSW	“Least” Least Significant Word (16bit)
RO	Read Only
RW*	Read-Write: REGISTERS CONTAINED IN FLASH MEMORY: WRITABLE ABOUT 10,000 TIMES MAXIMUM
RW**	Read-Write: REGISTERS THAT CAN BE WRITTEN ONLY AFTER WRITING THE COMMAND "ENABLE WRITE CUSTOM ENERGIES = 49616"
UNSIGNED 16 BIT	Unsigned integer register that can assume values from 0 to 65535
SIGNED 16 BIT	Signed integer register that can take values from -32768 to +32767
UNSIGNED 32 BIT	Unsigned integer register that can assume values from 0 to 4294967296
SIGNED 32 BIT	Signed integer register that can take values from -2147483648 to 2147483647
UNSIGNED 64 BIT	Unsigned integer register that can assume values from 0 to 18446744073709551615
SIGNED 64 BIT	Signed integer register that can assume values from -2^63 to 2^63-1
FLOAT 32 BIT	32-bit, single-precision floating-point register (IEEE 754) https://en.wikipedia.org/wiki/IEEE_754
BIT	Boolean register, which can take the values 0 (false) or 1 (true)

13.1. NUMBERING OF "0-BASED" OR "1-BASED" MODBUS ADDRESSES

According to the Modbus standard the Holding Registers are addressable from 0 to 65535, there are 2 different conventions for numbering the addresses: "0-BASED" and "1-BASED".
For greater clarity, Seneca shows its register tables in both conventions.

⚠ ATTENTION!

carefully read the documentation of the Modbus Master DEVICE
IN ORDER to understand which of the TWO conventions the manufacturer has decided to use.
SENECA USES THE “1 BASED” CONVENTION FOR ITS PRODUCTS

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

13.2. NUMBERING OF MODBUS ADDRESSES WITH "0-BASED" CONVENTION

The numbering is:

HOLDING REGISTER MODBUS ADDRESS (OFFSET)	***MEANING***
0	FIRST REGISTER
1	SECOND REGISTER
2	THIRD REGISTER
3	FOURTH REGISTER
4	FIFTH REGISTER

Therefore, the first register is at address 0.
In the following tables, this convention is indicated with ***"ADDRESS OFFSET".***

13.3. NUMBERING OF MODBUS ADDRESSES WITH "1 BASED" CONVENTION (STANDARD)

The numbering is that established by the Modbus consortium and is of the type:

HOLDING REGISTER MODBUS ADDRESS 4x	***MEANING***
40001	FIRST REGISTER
40002	SECOND REGISTER
40003	THIRD REGISTER
40004	FOURTH REGISTER
40005	FIFTH REGISTER

This convention is indicated with ***"ADDRESS 4x"*** since a 40000 is added to the address so that the first Modbus register is 40001.
A further convention is also possible where the number 4 is omitted in front of the register address:

HOLDING MODBUS ADDRESS WITHOUT 4x	***MEANING***
1	FIRST REGISTER
2	SECOND REGISTER
3	THIRD REGISTER
4	FOURTH REGISTER
5	FIFTH REGISTER

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

13.4. BIT CONVENTION WITHIN A MODBUS HOLDING REGISTER

A Modbus Holding Register consists of 16 bits with the following convention:

BIT 15	BIT 14	BIT 13	BIT 12	BIT 11	BIT 10	BIT 9	BIT 8	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0

For instance, if the value of the register in decimal is
12300
the value 12300 in hexadecimal is:
0x300C

the hexadecimal 0x300C in binary value is:
11 0000 0000 1100

So, using the above convention, we get:

BIT 15	BIT 14	BIT 13	BIT 12	BIT 11	BIT 10	BIT 9	BIT 8	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
0	0	1	1	0	0	0	0	0	0	0	0	1	1	0	0

13.5. MSB and LSB BYTE CONVENTION WITHIN A MODBUS HOLDING REGISTER

A Modbus Holding Register consists of 16 bits with the following convention:

BIT 15	BIT 14	BIT 13	BIT 12	BIT 11	BIT 10	BIT 9	BIT 8	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0

LSB Byte (Least Significant Byte) defines the 8 bits ranging from Bit 0 to Bit 7 included, we define MSB Byte (Most Significant Byte) the 8 bits ranging from Bit 8 to Bit 15 inclusive:

BIT 15	BIT 14	BIT 13	BIT 12	BIT 11	BIT 10	BIT 9	BIT 8	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE MSB								BYTE LSB							

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

13.6. REPRESENTATION OF A 32-BIT VALUE IN TWO CONSECUTIVE MODBUS HOLDING REGISTERS

The representation of a 32-bit value in the Modbus Holding Registers is made using 2 consecutive Holding Registers (a Holding Register is a 16-bit register). To obtain the 32-bit value it is therefore necessary to read two consecutive registers:
For example, if register 40064 contains the 16 most significant bits (MSW) while register 40065 contains the least significant 16 bits (LSW), the 32-bit value is obtained by composing the 2 registers:

BIT 15	BIT 14	BIT 13	BIT 12	BIT 11	BIT 10	BIT 9	BIT 8	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
40064 MOST SIGNIFICANT WORD															

BIT 15	BIT 14	BIT 13	BIT 12	BIT 11	BIT 10	BIT 9	BIT 8	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
40065 LEAST SIGNIFICANT WORD															

$$Value_{32bit} = Register_{LSW} + (Register_{MSW} * 65536)$$

In the reading registers it is possible to swap the most significant word with the least significant word, therefore it is possible to obtain 40064 as LSW and 40065 as MSW.


ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

13.7. TYPE OF 32-BIT FLOATING POINT DATA (IEEE 754)

The IEEE 754 standard (https://en.wikipedia.org/wiki/IEEE_754) defines the format for representing floating point numbers.
As already mentioned, since it is a 32-bit data type, its representation occupies two 16-bit holding registers.
To obtain a binary/hexadecimal conversion of a floating point value it is possible to refer to an online converter at this address:

http://www.h-schmidt.net/FloatConverter/IEEE754.html

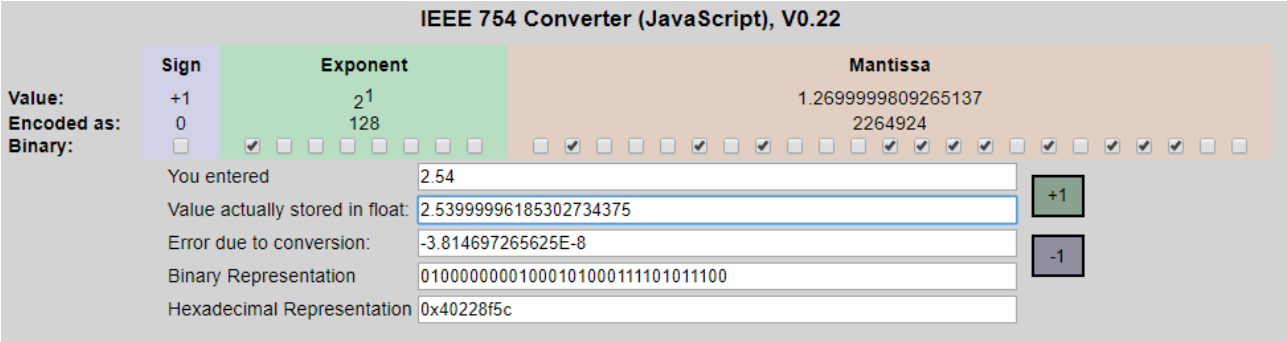

Using the last representation the value 2.54 is represented at 32 bits as:

0x4022 8F5C

Since we have 16-bit registers available, the value must be divided into MSW and LSW:

0x4022 (16418 decimal) are the 16 most significant bits (MSW) while 0x8F5C (36700 decimal) are the 16 least significant bits (LSW).

ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED WITHOUT PRIOR PERMISSION.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000